

**New York State Electric & Gas Corporation**

**Jennison Transmission Solution Project**

**Exhibit 5**

**Design Drawings**

**Part 7 of 12**



CADD DRAWING DO NOT REVISE MANUALLY.

PLAN	SURVEYED	DATE
NOTEBOOK NO.	REVIEWED	BY
	ROW CHKD	

PLAN SCALE:  
1" = 200'


THIS DOCUMENT AND ANY ATTACHMENTS ARE CONSIDERED:  
PROTECTED CRITICAL INFRASTRUCTURE INFORMATION

PROFILE	SURVEYED	DATE
NOTEBOOK NO.	REVIEWED	BY
	NOTES REDUCED	

PROFILE SCALE:  
HORZ. 1" = 200'  
VERT. 1" = 60'



NOT VALID AS DETAIL ENGINEERING OR FOR CONSTRUCTION

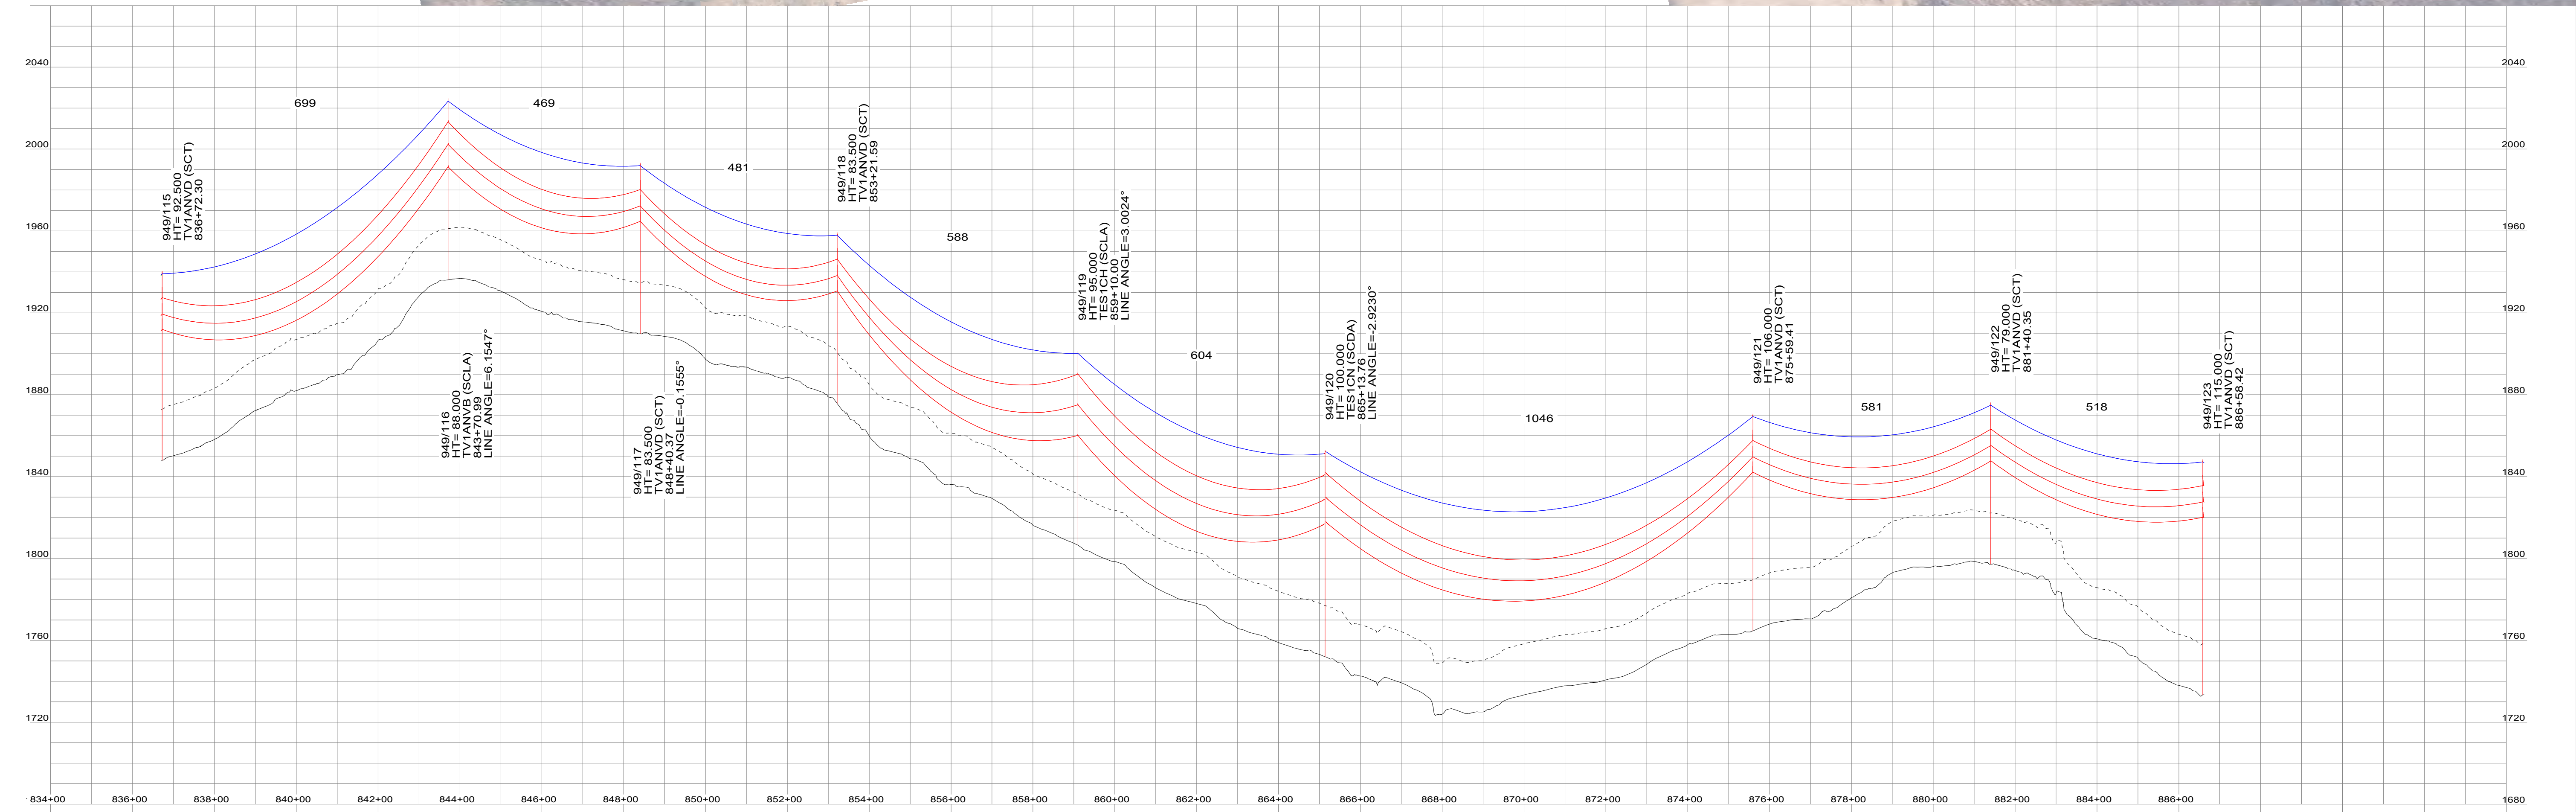

UNDERBUILD CONSTRUCTION TYPE	NEUTRAL CONDUCTOR TYPE	OHSW TYPE	CONDUCTOR TYPE	YR. CONST.	PE STAMP																
TENSION	TENSION	DNO - 11467 72 FIBER 7#7 ALUMOWELD	1192.5 KCMIL BUNTING ACSR	IWO																	
DESIGN TEMP.	DESIGN TEMP.	4,800 - 6,000 LBS (NESC HEAVY 250B)	8,000 - 12,000 LBS (NESC HEAVY 250B)	NOTES: HEIGHT IN STRUCTURE COMMENTS REFERS TO ABOVE GROUND HEIGHT																	
		120 DEG MAX SAG FE	260 DEG MAX SAG FE	REV. DATE BY DESCRIPTION APP.	<table border="1"> <tr> <td>0-0D</td> <td>09/06/2024</td> <td>HAR/DAS</td> <td>ISSUED FOR PERMITTING</td> </tr> <tr> <td>0-0C</td> <td>05/16/2024</td> <td>HAR/DAS</td> <td>L949 REBUILD</td> </tr> <tr> <td>0-0B</td> <td>08/14/2023</td> <td>ADR/DAS</td> <td>L949 REBUILD</td> </tr> <tr> <td>0-0A</td> <td>07/06/2023</td> <td>ADR/DAS</td> <td>L949 REBUILD</td> </tr> </table>	0-0D	09/06/2024	HAR/DAS	ISSUED FOR PERMITTING	0-0C	05/16/2024	HAR/DAS	L949 REBUILD	0-0B	08/14/2023	ADR/DAS	L949 REBUILD	0-0A	07/06/2023	ADR/DAS	L949 REBUILD
0-0D	09/06/2024	HAR/DAS	ISSUED FOR PERMITTING																		
0-0C	05/16/2024	HAR/DAS	L949 REBUILD																		
0-0B	08/14/2023	ADR/DAS	L949 REBUILD																		
0-0A	07/06/2023	ADR/DAS	L949 REBUILD																		
<p style="text-align: center;">AVANGRID ENGINEERING CONFIDENTIAL, PROPRIETARY AND TRADE SECRET INFORMATION PROPERTY OF AVANGRID</p> <p style="text-align: center;">JENNSON TRANSMISSION SOLUTIONS PROJECT 115KV L949 JENNSON S/S TO DELHI S/S PLAN AND PROFILE DRAWINGS SHEET 39 OF 51</p>																					
				<table border="1"> <tr> <td>DR.</td> <td>HAR/DAS</td> <td>MILE</td> <td>FILE:</td> </tr> <tr> <td>CK.</td> <td>ADR/DAS</td> <td>NO.</td> <td></td> </tr> <tr> <td>APP.</td> <td>ZRH/DAS</td> <td></td> <td></td> </tr> <tr> <td>REV.</td> <td>DATE:</td> <td>05/16/2024</td> <td></td> </tr> </table>		DR.	HAR/DAS	MILE	FILE:	CK.	ADR/DAS	NO.		APP.	ZRH/DAS			REV.	DATE:	05/16/2024	
DR.	HAR/DAS	MILE	FILE:																		
CK.	ADR/DAS	NO.																			
APP.	ZRH/DAS																				
REV.	DATE:	05/16/2024																			



ANSI D CADD DRAWING DO NOT REVISE MANUALLY.


PLAN	DATE
NOTEBOOK NO.	BY
SURVEYED	REVIEWED
ROW	CHKD

PLAN SCALE:  
1" = 200'


THIS DOCUMENT AND ANY ATTACHMENTS ARE CONSIDERED:  
PROTECTED CRITICAL INFRASTRUCTURE INFORMATION

PROFILE	DATE
NOTEBOOK NO.	BY
SURVEYED	REVIEWED
NOTES REDUCED	

PROFILE SCALE:  
HORZ. 1" = 200'  
VERT. 1" = 60'

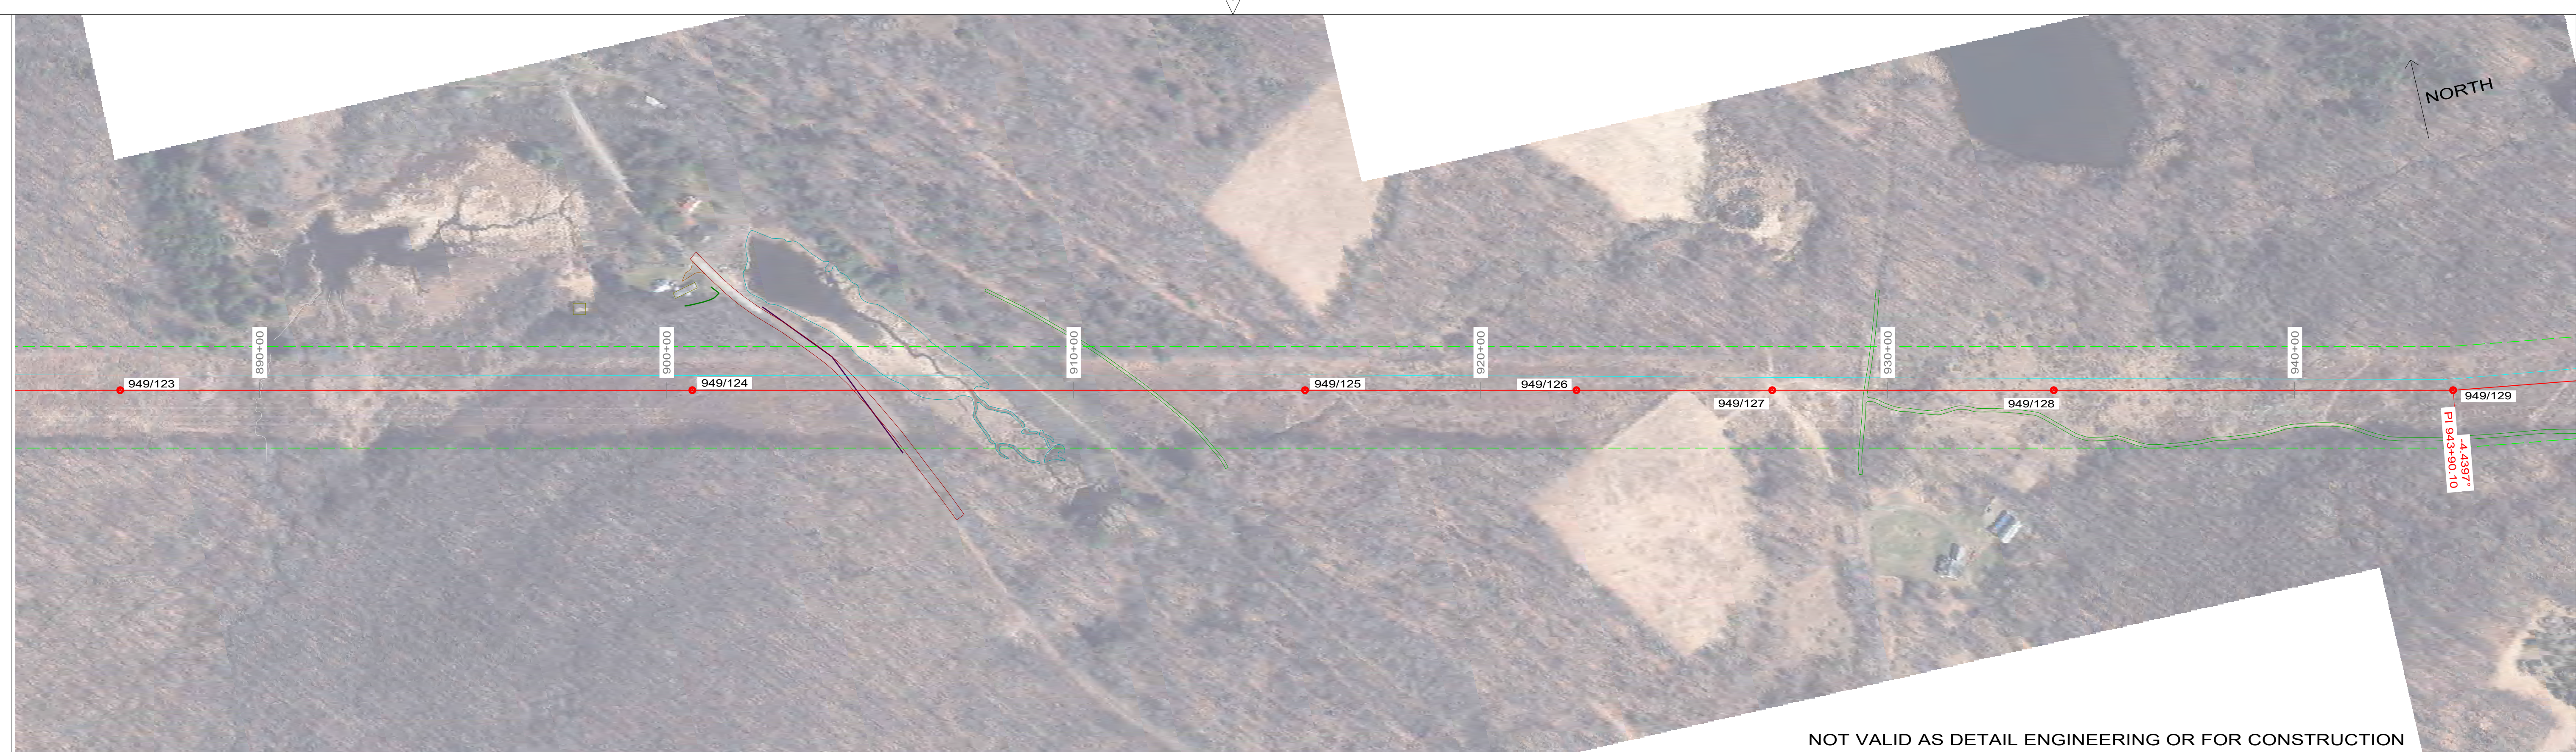

NOT VALID AS DETAIL ENGINEERING OR FOR CONSTRUCTION

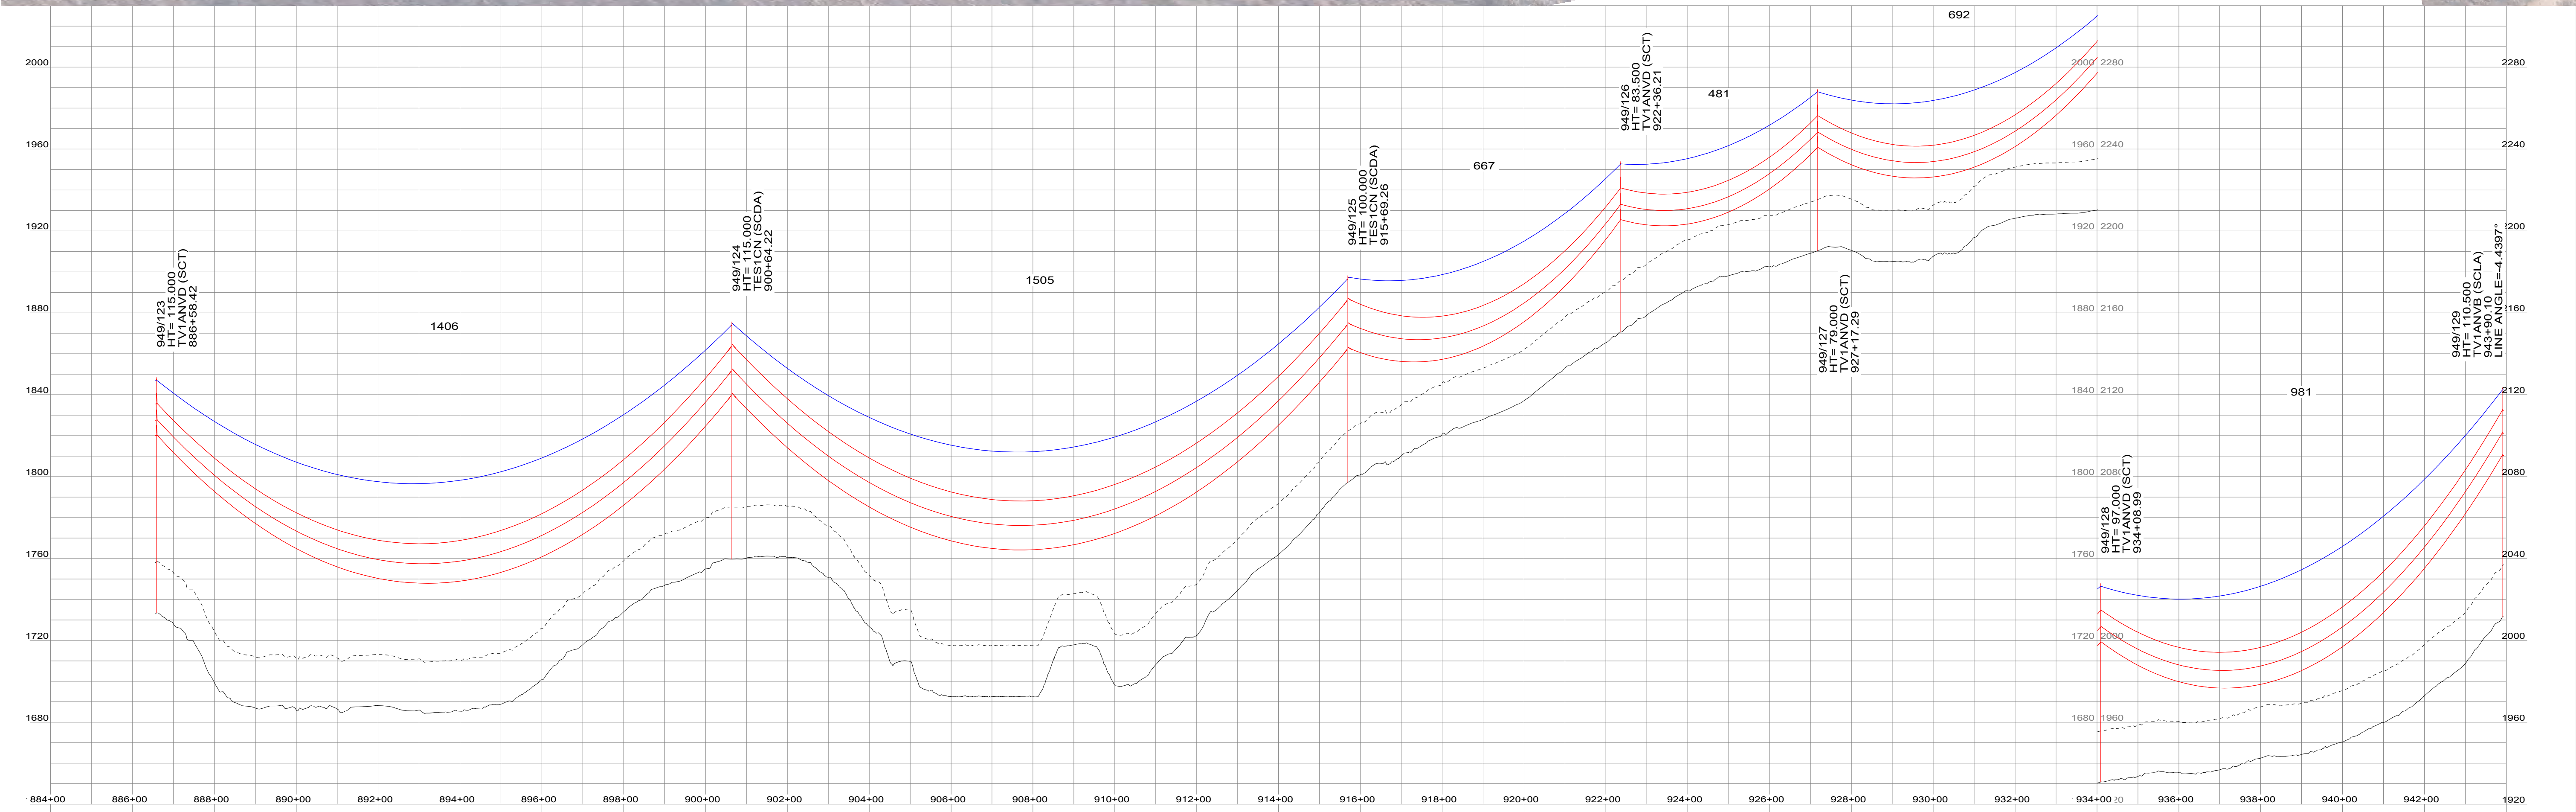

UNDERBUILD CONSTRUCTION TYPE	NEUTRAL CONDUCTOR TYPE	OHSW TYPE	CONDUCTOR TYPE	YR. CONST.	PE STAMP	<p>AVANGRID ENGINEERING CONFIDENTIAL, PROPRIETARY AND TRADE SECRET INFORMATION PROPERTY OF AVANGRID</p> <p><b>NYSEG</b></p> <p>JENNISON TRANSMISSION SOLUTIONS PROJECT 115KV L949 JENNISON S/S TO DELHI S/S PLAN AND PROFILE DRAWINGS</p> <p>SHEET 40 OF 51</p> <p>REBUILD NYSEG - ONEONTA</p>																								
TENSION	TENSION	DNO - 11467 72 FIBER	1192.5 KCMIL BUNTING ACSR	IWO	<table border="1"> <tr> <th>REV.</th> <th>DATE</th> <th>BY</th> <th>DESCRIPTION</th> <th>APP.</th> </tr> <tr> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> </tr> </table>		REV.	DATE	BY	DESCRIPTION	APP.																			
REV.	DATE	BY	DESCRIPTION	APP.																										
DESIGN TEMP.	DESIGN TEMP.	4,800 - 6,000 LBS (NESC HEAVY 250B)	8,000 - 12,000 LBS (NESC HEAVY 250B)	NOTES: HEIGHT IN STRUCTURE COMMENTS REFERS TO ABOVE GROUND HEIGHT	<table border="1"> <tr> <th>REV.</th> <th>DATE</th> <th>BY</th> <th>DESCRIPTION</th> <th>APP.</th> </tr> <tr> <td>0-0D</td> <td>09/06/2024</td> <td>HAR/DAS</td> <td>ISSUED FOR PERMITTING</td> <td></td> </tr> <tr> <td>0-0C</td> <td>05/16/2024</td> <td>HAR/DAS</td> <td>L949 REBUILD</td> <td></td> </tr> <tr> <td>0-0B</td> <td>08/14/2023</td> <td>ADR/DAS</td> <td>L949 REBUILD</td> <td></td> </tr> <tr> <td>0-0A</td> <td>07/06/2023</td> <td>ADR/DAS</td> <td>L949 REBUILD</td> <td></td> </tr> </table>	REV.	DATE	BY	DESCRIPTION	APP.	0-0D	09/06/2024	HAR/DAS	ISSUED FOR PERMITTING		0-0C	05/16/2024	HAR/DAS	L949 REBUILD		0-0B	08/14/2023	ADR/DAS	L949 REBUILD		0-0A	07/06/2023	ADR/DAS	L949 REBUILD	
REV.	DATE	BY	DESCRIPTION	APP.																										
0-0D	09/06/2024	HAR/DAS	ISSUED FOR PERMITTING																											
0-0C	05/16/2024	HAR/DAS	L949 REBUILD																											
0-0B	08/14/2023	ADR/DAS	L949 REBUILD																											
0-0A	07/06/2023	ADR/DAS	L949 REBUILD																											
DESIGN TEMP.	DESIGN TEMP.	120 DEG MAX SAG FE	260 DEG MAX SAG FE	DATE: 05/16/2024	REV. 0-0D																									



CADD DRAWING DO NOT REVISE MANUALLY.

PLAN	SURVEYED	DATE
NOTEBOOK NO.	REVIEWED	
	ROW CHKD	

PLAN SCALE:  
1" = 200'


THIS DOCUMENT AND ANY ATTACHMENTS ARE CONSIDERED PROTECTED CRITICAL INFRASTRUCTURE INFORMATION

PROFILE	SURVEYED	DATE
NOTEBOOK NO.	REVIEWED	
	NOTES REDUCED	

PROFILE SCALE:  
HORZ. 1" = 200'  
VERT. 1" = 60'



NOT VALID AS DETAIL ENGINEERING OR FOR CONSTRUCTION

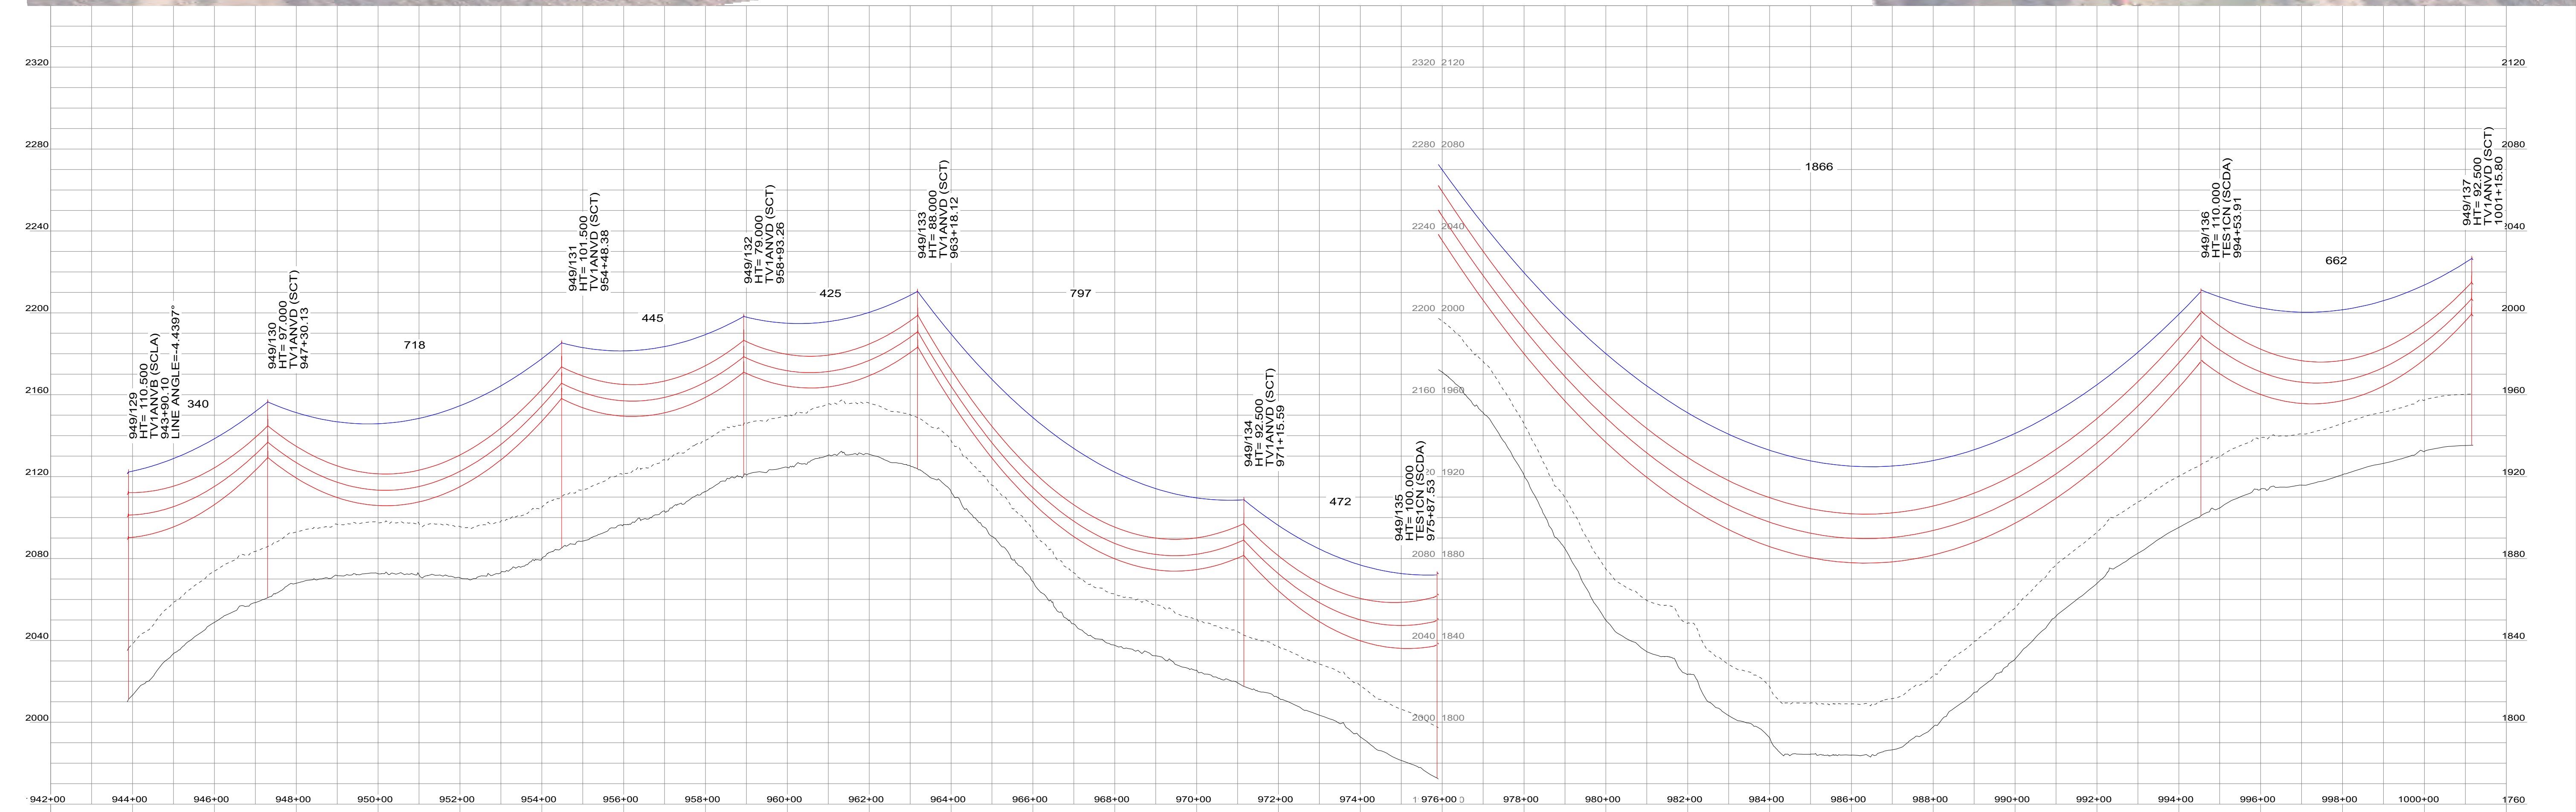

UNDERBUILD CONSTRUCTION TYPE	NEUTRAL CONDUCTOR TYPE	OHSW TYPE	CONDUCTOR TYPE	YR. CONST.	PE STAMP
TENSION	TENSION	DNO - 11467 72 FIBER	1192.5 KCMIL BUNTING ACSR	W/O	
DESIGN TEMP.	DESIGN TEMP.	4,800 - 6,000 LBS (NESC HEAVY 250B)	8,000 - 12,000 LBS (NESC HEAVY 250B)	NOTES: HEIGHT IN STRUCTURE COMMENTS REFERS TO ABOVE GROUND HEIGHT	
		120 DEG MAX SAG FE	260 DEG MAX SAG FE	REV. DATE BY DESCRIPTION APP.	

AVANGRID ENGINEERING CONFIDENTIAL, PROPRIETARY AND TRADE SECRET INFORMATION PROPERTY OF AVANGRID						JENNSION TRANSMISSION SOLUTIONS PROJECT 115KV L949 JENNSION S/S TO DELHI S/S PLAN AND PROFILE DRAWINGS SHEET 41 OF 51	
0-0D	09/06/2024	HAR/DAS	ISSUED FOR PERMITTING	REBUILD NYSEG - ONEONTA		DR.	HAR/DAS
0-0C	05/16/2024	HAR/DAS	L949 REBUILD	FILE:		CK.	ADR/DAS
0-0B	08/14/2023	ADR/DAS	L949 REBUILD	NO.		APP.	ZRH/DAS
0-0A	07/06/2023	ADR/DAS	L949 REBUILD	REV.		DATE:	05/16/2024
REV.	DATE	BY	DESCRIPTION	APP.	DATE:	05/16/2024	0-0D



CADD DRAWING DO NOT REVISE MANUALLY.

PLAN	SURVEYED	DATE
NOTEBOOK NO.	REVIEWED	BY
	ROW CHD	

PLAN SCALE:  
1" = 200'


THIS DOCUMENT AND ANY ATTACHMENTS ARE CONSIDERED PROTECTED CRITICAL INFRASTRUCTURE INFORMATION

PROFILE	SURVEYED	DATE
NOTEBOOK NO.	REVIEWED	BY
	NOTES REDUCED	

PROFILE SCALE:  
HORZ. 1" = 200'  
VERT. 1" = 60'



NOT VALID AS DETAIL ENGINEERING OR FOR CONSTRUCTION

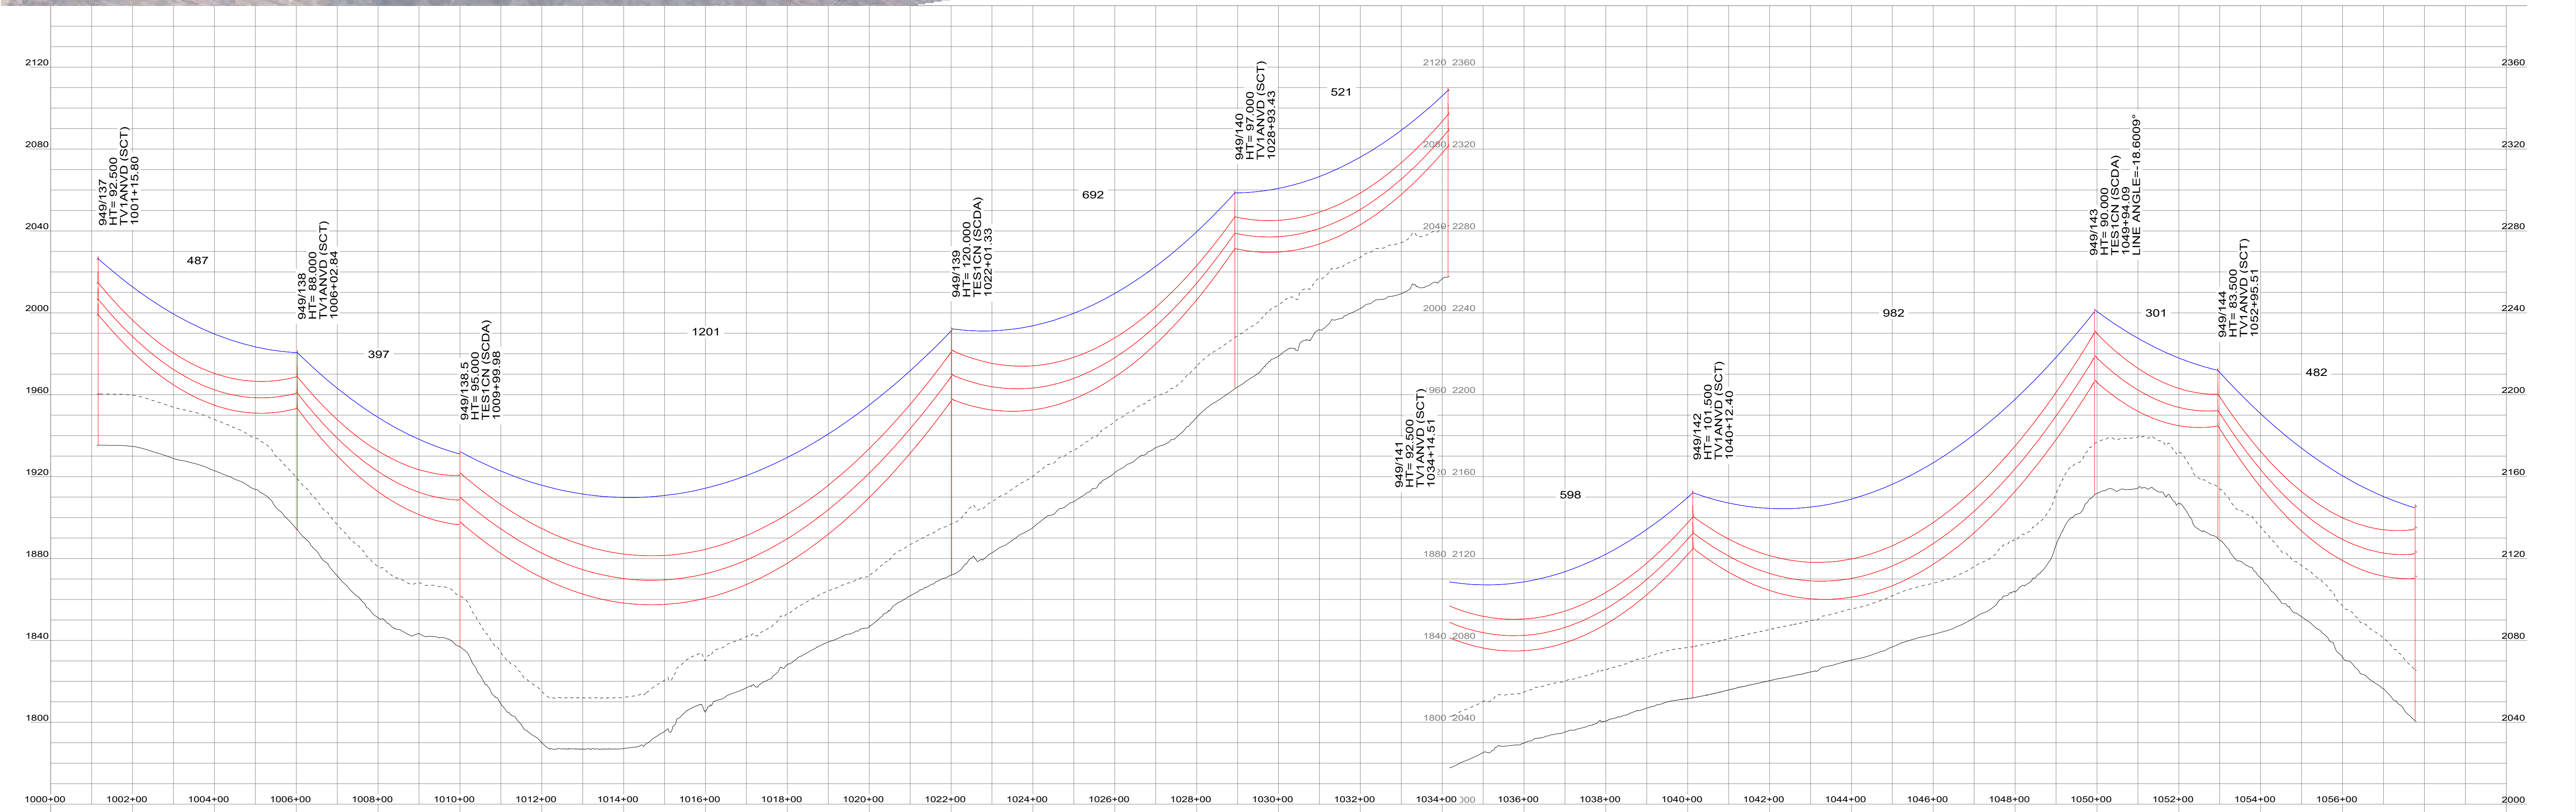

UNDERBUILD CONSTRUCTION TYPE	NEUTRAL CONDUCTOR TYPE	OHSW TYPE	CONDUCTOR TYPE	YR. CONST.	PE STAMP		JENNSON TRANSMISSION SOLUTIONS PROJECT 115KV L949 JENNSON S/S TO DELHI S/S PLAN AND PROFILE DRAWINGS SHEET 42 OF 51
TENSION	TENSION	DNO - 11467 72 FIBER	1192.5 KCMIL BUNTING ACSR	W/O	AVANGRID ENGINEERING CONFIDENTIAL, PROPRIETARY AND TRADE SECRET INFORMATION PROPERTY OF AVANGRID		
DESIGN TEMP.	DESIGN TEMP.	4,800 - 6,000 LBS (NESC HEAVY 250B)	8,000 - 12,000 LBS (NESC HEAVY 250B)	NOTES: HEIGHT IN STRUCTURE COMMENTS REFERS TO ABOVE GROUND HEIGHT	0-0D 09/06/2024 HAR/DAS ISSUED FOR PERMITTING 0-0C 05/16/2024 HAR/DAS L949 REBUILD 0-0B 08/14/2023 ADR/DAS L949 REBUILD 0-0A 07/06/2023 ADR/DAS L949 REBUILD	REBUILD NYSEG - ONEONTA DR. HAR/DAS MILE FILE: CK. ADR/DAS NO. APP. ZRH/DAS	
		120 DEG MAX SAG FE	260 DEG MAX SAG FE	REV. DATE BY DESCRIPTION APP.	REV. DATE BY DESCRIPTION APP.	DATE: 05/16/2024	REV. 0-0D



ANSI D CADD DRAWING DO NOT REVISE MANUALLY.

PLAN	DATE
NOTEBOOK NO.	BY
SURVEYED	REVIEWED
ROW CHKD	

PLAN SCALE:  
1" = 200'


PROFILE	DATE
NOTEBOOK NO.	BY
SURVEYED	REVIEWED
NOTES REDUCED	

PROFILE SCALE:  
HORZ. 1" = 200'  
VERT. 1" = 60'

THIS DOCUMENT AND ANY ATTACHMENTS ARE CONSIDERED PROTECTED CRITICAL INFRASTRUCTURE INFORMATION



NOT VALID AS DETAIL ENGINEERING OR FOR CONSTRUCTION

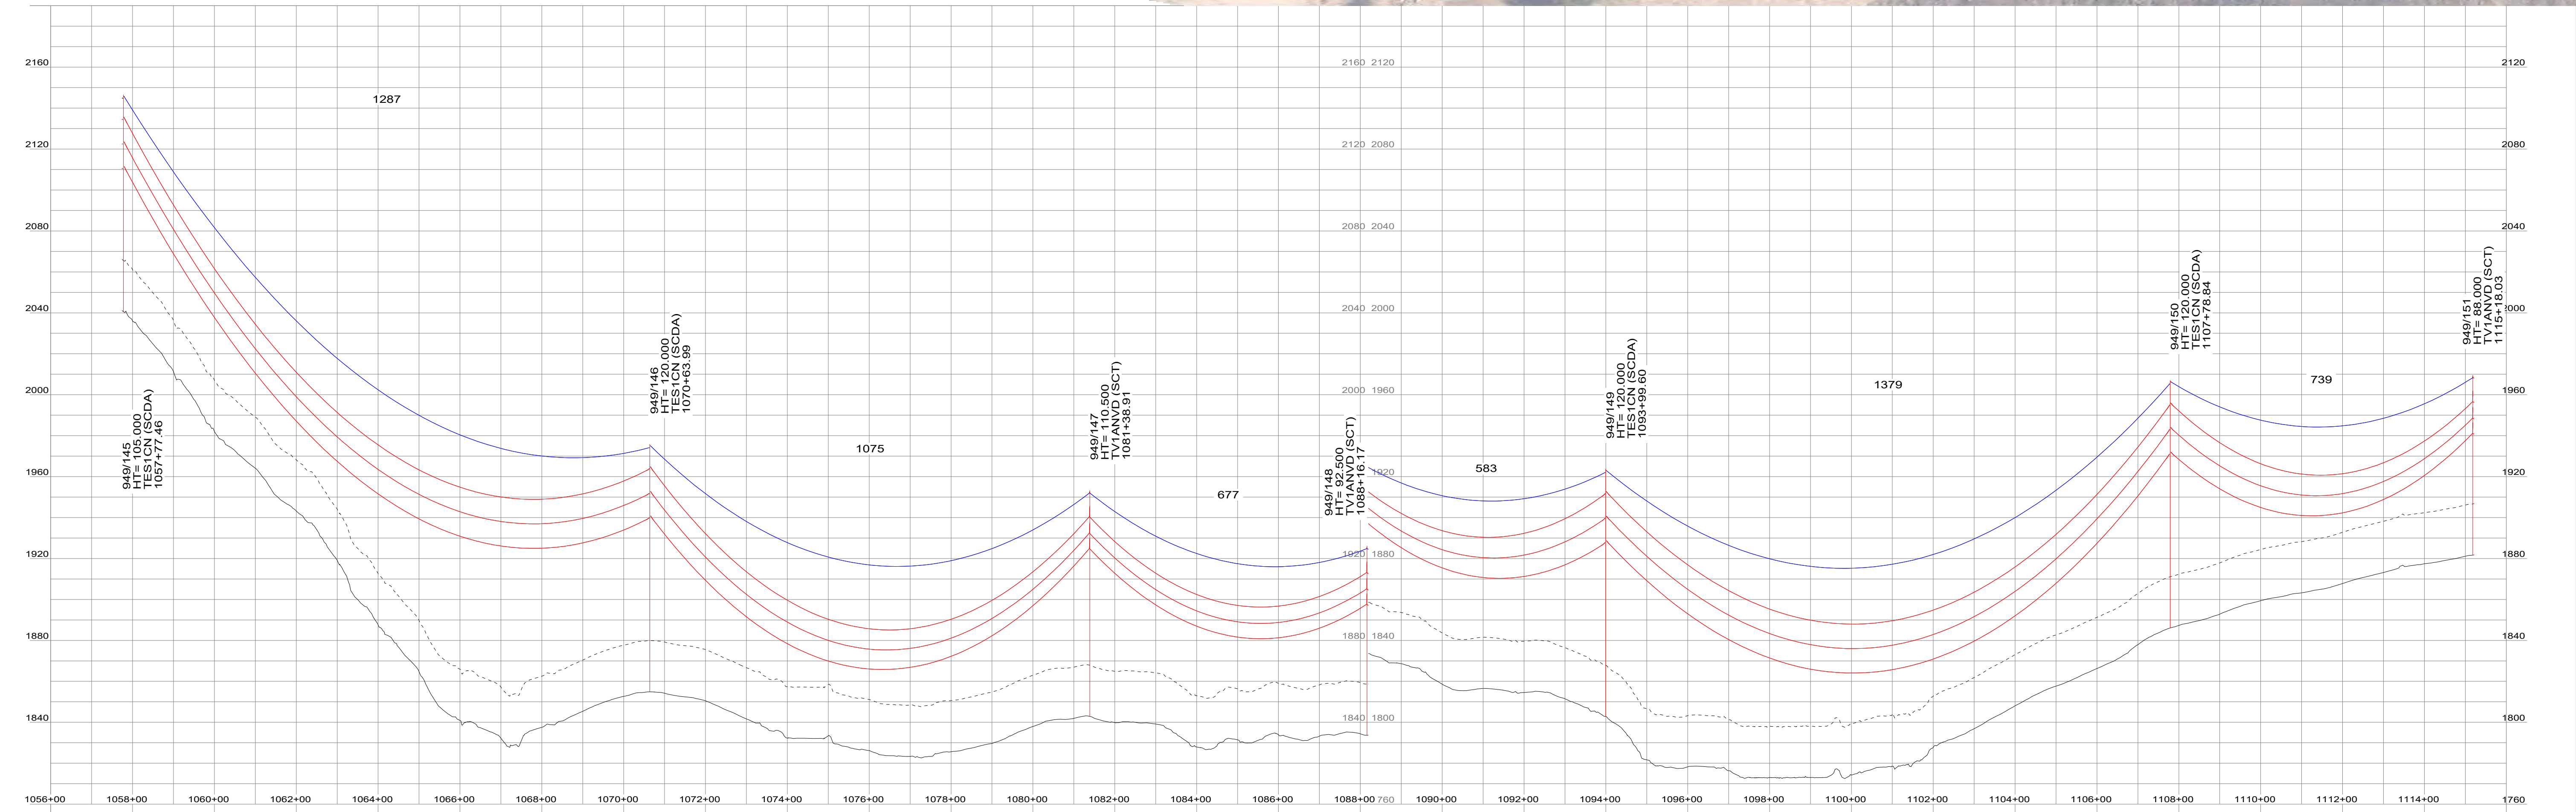

UNDERBUILD CONSTRUCTION TYPE	NEUTRAL CONDUCTOR TYPE	OHSW TYPE	CONDUCTOR TYPE	YR. CONST.	W/O	PE STAMP	<p>AVANGRID ENGINEERING CONFIDENTIAL, PROPRIETARY AND TRADE SECRET INFORMATION PROPERTY OF AVANGRID</p> <p>JENNISON TRANSMISSION SOLUTIONS PROJECT 115KV L949 JENNISON S/S TO DELHI S/S PLAN AND PROFILE DRAWINGS SHEET 43 OF 51</p>																		
TENSION	TENSION	DNO - 11467 72 FIBER 4,800 - 6,000 LBS (NESC HEAVY 250B)	1192.5 KCMIL BUNTING ACSR 8,000 - 12,000 LBS (NESC HEAVY 250B)	NOTES: HEIGHT IN STRUCTURE COMMENTS REFERS TO ABOVE GROUND HEIGHT																					
DESIGN TEMP.	DESIGN TEMP.	120 DEG MAX SAG FE	260 DEG MAX SAG FE	REV.	DATE	BY	DESCRIPTION	APP.	<table border="1"> <tr> <td>DR.</td> <td>HAR/DAS</td> <td>09/06/2024</td> <td>ISSUED FOR PERMITTING</td> </tr> <tr> <td>CK.</td> <td>ADR/DAS</td> <td>05/16/2024</td> <td>L949 REBUILD</td> </tr> <tr> <td>APP.</td> <td>ZRH/DAS</td> <td>08/14/2023</td> <td>L949 REBUILD</td> </tr> <tr> <td>APP.</td> <td>ADR/DAS</td> <td>07/06/2023</td> <td>L949 REBUILD</td> </tr> </table>	DR.	HAR/DAS	09/06/2024	ISSUED FOR PERMITTING	CK.	ADR/DAS	05/16/2024	L949 REBUILD	APP.	ZRH/DAS	08/14/2023	L949 REBUILD	APP.	ADR/DAS	07/06/2023	L949 REBUILD
DR.	HAR/DAS	09/06/2024	ISSUED FOR PERMITTING																						
CK.	ADR/DAS	05/16/2024	L949 REBUILD																						
APP.	ZRH/DAS	08/14/2023	L949 REBUILD																						
APP.	ADR/DAS	07/06/2023	L949 REBUILD																						